
Botania Stage 7

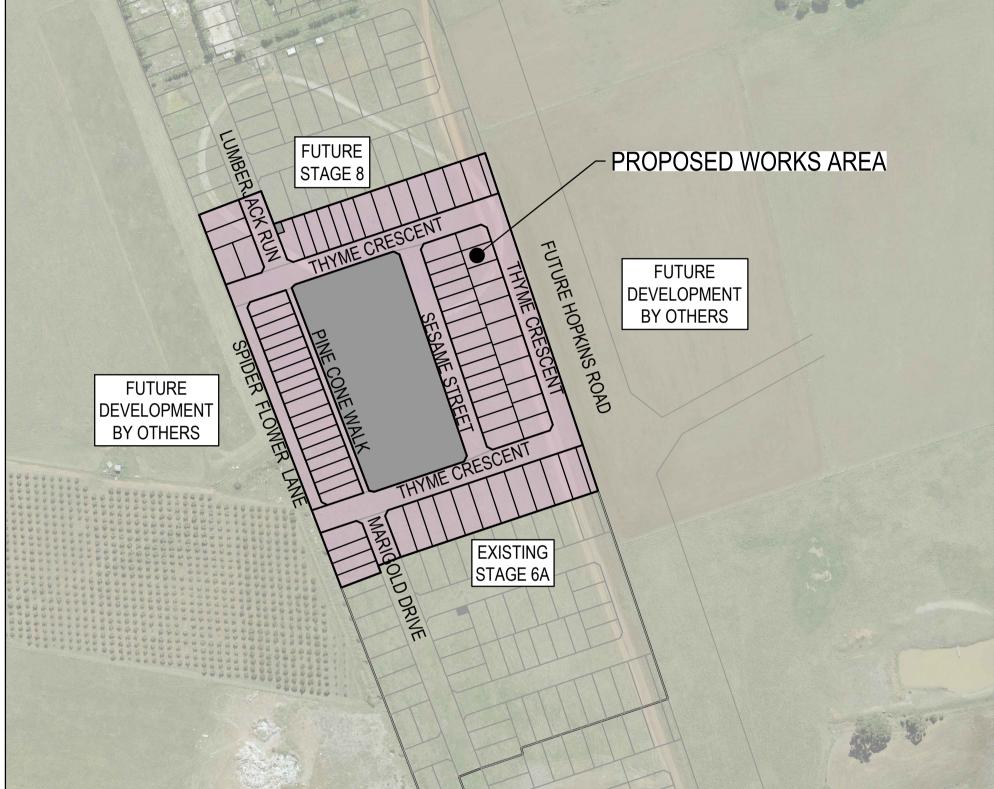

Drawing Index

3070E-007-101 Cover Plan & General Notes 3070E-007-111 Layout Plan - 1 3070E-007-112 Layout Plan - 2 3070E-007-171 Signage & Linemarking Plan 3070E-007-181 Intersection Detail Plan & Lip Profiles - 1 3070E-007-182 Intersection Detail Plan & Lip Profiles - 2 3070E-007-183 Intersection Detail Plan & Lip Profiles - 3 3070E-007-201 Longitudinal Sections - 1 3070E-007-202 Longitudinal Sections - 2 3070E-007-203 Longitudinal Sections - 3 3070E-007-251 Cross Sections: Lumberjack Run 3070E-007-252 Cross Sections: Sesame Street 3070E-007-253 Cross Sections: Marigold Drive 3070E-007-254 Cross Sections: Thyme Crescent Ch 0.00 - Ch 140.88 3070E-007-255 Cross Sections: Thyme Crescent Ch 153.38 - Ch 287.38 3070E-007-256 Cross Sections: Thyme Crescent Ch 299.88 - Ch 440.88 3070E-007-257 Cross Sections: Thyme Crescent Ch 457.88 - Ch 512.92 3070E-007-258 Cross Sections: Spider Flower Lane 3070E-007-259 Cross Sections: Pine Cone Walk 3070E-007-301 Drainage Longitudinal Sections - 1 3070E-007-302 Drainage Longitudinal Sections - 2 3070E-007-303 Drainage Longitudinal Sections - 3 3070E-007-304 Drainage Longitudinal Sections - 4 3070E-007-351 Pit Schedule 3070E-007-410 Pavement Details - 1 3070E-007-411 Concrete Jointing Details 3070E-007-412 Passive Irrigation System Plan

DRAFTER

J.HICKS

DESIGNER

M.MANAFI

CHECKER

S.MACLAREN

APPROVER

M.BOUWMEESTE

COPYRIGHT © 2020 AEROMETREX PTY LTD, COPYRIGHT © 2020 METROMAP

MELTON **APPROVED** DETAILED ENGINEERING PLANS Nihal Jayasekara **ENGINEERING SERVICES** Date: 5/04/2023


PLAN OF SUB. NO.

PERMIT REF. NO

SCALE AS SHOWN AT A1

Global-Mark.com.au® PA2018/6004/1

ISSUED FOR CONSTRUCTION





Ph 03 9514 1500



Botania - Stage 7 Melton City Council Road and Drainage Cover Plan & General Notes

MELWAYS REF PROJECT / DRAWING No.



GROWLAND

DWG PATH: V:_Vault\Projects_Urban\3070E-Botania\3070E-007\Dwgs\3070E-007-101.dwg PRINTED BY: JH16392 on 23/11/2022 at 02:01:10 PM

3070E-007-413 Passive Irrigation Detail 3070E-007-421 Typical Cross Sections

3070E-007-500 Safety In Design

REV DATE AMENDMENT / REVISION DESCRIPTION

0 23.11.22 ISSUED FOR CONSTRUCTION

MINES (TRENCHES) REGULATIONS 1982.

THE CONTRACTOR SHALL 3.1. COMPLY WITH THE SAFETY REQUIREMENTS OF THE MINES ACT, GENERAL REGULATIONS AND STATUTORY RULES, AND THE

NOTIFY THE OCCUPATIONAL HEALTH AND SAFETY AUTHORITY OF HIS INTENTION TO COMMENCE TRENCHING OPERATIONS WHERE TRENCHES ARE 1.5 METRES OR DEEPER.

1. ALL WORKS TO BE CARRIED OUT IN ACCORDANCE WITH A.S. 4000-1992 GENERAL CONDITIONS OF CONTRACT AND CURRENT MELTON SHIRE COUNCIL SPECIFICATIONS AND EDCM ADDENDUM STANDARD DRAWINGS AND TO THE SATISFACTION OF THE SUPERVISING

THE CONTRACTOR IS RESPONSIBLE FOR SAFETY OF WORK ON SITE IN ACCORDANCE WITH APPROPRIATE LEGISLATION. THEY SHALL ERECT AND MAINTAIN ALL SHORING, PLANKING AND STRUTTING, DEWATERING DEVICES, BARRICADES, SIGNS, LIGHTS, ETC. NECESSARY TO KEEP WORKS IN A SAFE AND STABLE CONDITION, AND TO PROTECT THE PUBLIC FROM HAZARDS ASSOCIATED WITH

ENSURE THAT THE MINE MANAGER OR HIS DEPUTY AS REQUIRED BY THE REGULATIONS IS IN ATTENDANCE WHEN TRENCHING OPERATIONS ARE IN PROGRESS.

4. THE CONTRACTOR IS TO NOTIFY COUNCIL AND ALL SERVICE AUTHORITIES SEVEN (7) DAYS PRIOR TO COMMENCEMENT OF CONSTRUCTION.

THE LOCATION OF EXISTING SERVICES SHOULD BE DETERMINED BY THE CONTRACTOR PRIOR TO COMMENCING ANY EXCAVATION BY CONTACTING ALL RELEVENT SERVICE AUTHORITIES. ANY EXISTING SERVICES SHOWN ON THE DRAWINGS ARE OFFERED AS A GUIDE ONLY AND ARE NOT GUARANTEED AS CORRECT.

6. TREES MARKED ON THE APPROVED PLANS FOR REMOVAL MUST BE REMOVED FROM THE SITE PRIOR TO THE COMMENCEMENT OF WORKS. NO EXCAVATION SHALL BE CARRIED OUT WITHIN 5.0m OF ANY EXISTING TREE UNTIL APPROVAL HAS BEEN GIVEN BY COUNCIL'S SUPERVISING OFFICER.

7. ALL ROAD CHAINAGES ARE MEASURED ALONG THE ROAD CENTRELINE EXCEPT KERB RETURNS AND COURTHEADS, WHERE LIP OF KERB CHAINAGES ARE SPECIFIED. ALL DIMENSIONS AND RADII ARE GIVEN TO THE LIP OF KERB. DO NOT SCALE OFF THESE DRAWINGS. WRITTEN DIMENSIONS ONLY SHALL BE USED. 8. THE CONTRACTOR WHEN ENGAGED IN BLASTING OPERATION, SHALL NOT BLAST WITHIN 4.5m OF AN EXISTING LINE OF WATER, GAS

OR SEWER PIPES OR WITHIN 15m OF ANY COMPLETED PART OF THE WORKS WITHOUT THE CONSENT OF THE ENGINEER AND MUST OBTAIN ALL RELEVANT PERMITS.

9. THE CONTRACTOR IS TO OBTAIN THE NECESSARY ROAD OPENING PERMIT PRIOR TO UNDERTAKING ANY WORKS WITHIN A PREVIOUSLY CONSTRUCTED ROADWAY.

10. ALL LEVELS ARE TO AUSTRALIAN HEIGHT DATUM.

GENERAL NOTES (MELTON CITY COUNCIL)

ENGINEER OR THEIR REPRESENTATIVE.

11. THE CONTRACTOR SHALL CO-OPERATE WITH OTHER AUTHORITIES AND SHALL ENSURE THAT ALL SERVICES ARE INSTALLED PRIOR TO THE FINAL PAVEMENT COURSE.

12. ANY EXISTING PAVEMENT OR DRAINAGE WORKS DAMAGED DURING CONSTRUCTION OR THE MAINTENANCE PERIOD TO BE REINSTATED TO THE SATISFACTION OF THE COUNCIL REPRESENTATIVE

13. TBM'S TO BE MAINTAINED AND PROTECTED BY THE CONTRACTOR FOR THE DURATION OF THE WORKS.

14. ALL CONCRETE TO BE USED IN THE CONTRACT WORKS SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 25MPa AT 28 DAYS.

15. THE CONTRACTOR IS TO ENSURE THAT HIS CONSTRUCTION PROCEDURES AND STANDARDS CONTROL THE VOLUME AND LOCATION FOR COLLECTION OF SEDIMENT DISCHARGE ACCORDING TO CURRENT EPA - ENVIRONMENTAL GUIDELINES FOR MAJOR CONSTRUCTION SITES. THE CONTRACTOR IS TO CONSTRUCT SEDIMENT TRAPS AT THE ENDS OF ALL TEMPORARY CHANNELS AND CATCH DRAINS. THEY ARE TO BE MAINTAINED THROUGH THE DURATION OF WORKS AND MAINTENANCE TO BE TRANSFERRED TO THE PRINCIPAL UPON COMPLETION OF THE WORKS.

16. ALL BATTERS TO BE 1 IN 6 UNLESS OTHERWISE INDICATED. FILLING IN PROPERTIES AND ROAD RESERVE IS TO BE CARRIED OUT USING APPROVED CLAY FILL. TOPSOIL AND ALL VEGETABLE MATTER TO BE STRIPPED FROM FILL SITE PRIOR TO FILLING. WHERE FILL IS IN EXCESS OF 300mm IN DEPTH, THE FILL IS TO BE LEVEL 1 IN ACCORDANCE WITH AS3798. EARTH FILL IS TO BE COMPACTED TO A RELATIVE COMPACTION COMPARED TO A STANDARD COMPACTION TEST AS SPECIFIED BY VIC ROADS OF - 100% FOR ALL FILL MATERIAL AND MATERIAL UNDER FILL THAT IS LESS THAN 450mm FROM THE SURFACE.

- 95% FOR ALL FILL GREATER THAN 450mm FROM THE SURFACE. ADDITIONAL AND OVEREXCAVATION SHALL BE BACKFILLED IN ACCORDANCE WITH THE PROVISIONS OF THE SPECIFICATION.

18. THE NATURE STRIPS AND CUT OR FILLED AREAS ARE TO BE TOPSOILED WITH 100mm OF APPROVED MATERIAL.

19. THE SUBGRADE BELOW ALL PAVEMENTS SHALL BE COMPACTED TO A DRY DENSITY NOT LESS THAN 97% OF THE MAX. FOUND IN STANDARD COMPACTION TEST IN AREAS OF CUT TO A DEPTH OF 150mm AND IN AREAS OF FILL TO A DEPTH OF 450mm.

20. THE RELATIVE COMPACTION OF CRUSHED ROCK FOR PAVEMENTS SHALL BE COMPLETED AT THE OPTIMUM MOISTURE CONTENT TO A DRY DENSITY (BASED ON THE PERCENTAGE OF THE MAXIMUM DRY DENSITY OBTAINED IN THE MODIFIED COMPACTION TEST) AS

- FOR DEPTH 0-100mm BELOW TOP OF BASE, RELATIVE COMPACTION OF 100%. - FOR DEPTH 100-300mm BELOW TOP OF BASE, RELATIVE COMPACTION OF 98%.

- FOR DEPTH OVER 300mm BELOW TOP OF BASE, RELATIVE COMPACTION OF 97%.

100mm NOMINAL DIAMETER SUBSOIL DRAIN SHALL BE PROVIDED BEHIND ALL KERB AND CHANNEL AS PER STANDARD DRAWING EDCM

22. CONDUIT LOCATIONS ARE SUBJECT TO AMENDMENT AND CONDUITS SHALL NOT BE LAID UNTIL WRITTEN APPROVAL IS GIVEN BY THE SUPERINTENDENT, BOTH KERBS ARE TO BE MARKED WITH THE LETTERS G.W AND T ABOVE CONDUIT LOCATIONS AS SPECIFIED. CONDUITS TO BE PLACED MINIMUM OF 5m FROM BOUNDARIES WHERE POSSIBLE AND TO THE SATISFACTION OF THE SUPERINTENDENT IN ACCORDANCE WITH COUNCIL STANDARD DRAWINGS. NBN CONDUITS WILL BE SUPPLIED BY NBN'S EXPENSE. IN TRENCHES EXCAVATED AND BACKFILLED BY THE CONTRACTOR. NBN SIZES VARIES - WHITE PVC NBN TO BE NOTIFIED 7 DAYS PRIOR TO PLACEMENT OF CONCRETE WORKS. GAS AND WATER CONDUITS TO BE 50mm DIA. HEAVY DUTY PVC LAID AT A MINIMUM DEPTH OF 600mm BELOW ROAD FINISHED SURFACE LEVELS. FOR DUAL WATER SUPPLY CONDUIT SHALL BE 100mm DIA.

ALL SERVICING TRENCHES UNDER ROADS, FOOTPATHS, DRIVEWAYS, PARKING BAYS ETC. ARE TO BE BACKFILLED WITH CLASS 2 FCR 24. ALL HOUSE DRAIN CONNECTIONS ARE TO BE LOCATED NO CLOSER THAT 6.00m FROM THE SIDE BOUNDARY OR FROM ANY EASEMENT ALONG THE SIDE BOUNDARY.

25. ALL PROPERTY INLETS TO BE LOCATED 1.0m FROM THE LOW SIDE BOUNDARY UNLESS OTHERWISE SHOWN. THEY ARE TO BE LAID AT

A MINIMUM DEPTH OF 400mm AS SPECIFIED IN THE STANDARD DRAWINGS.

26. DRAINAGE PITS SHALL BE CAST MONOLITHICALLY. CEMENT RENDER SHALL ONLY BE USED TO REPAIR DEFECTS. 27. ALL RESIDENTIAL FOOTPATHS TO BE MINIMUM 1.50m WIDE UNLESS OTHERWISE INDICATED. FOOTPATH TO BE 125mm DEPTH OF 25MPa

CONCRETE CENTRALLY REINFORCED WITH SL72 MESH, AS PER EDCM 401 ON 50mm COMPACTED DEPTH 20mm CLASS 3 FCR BASE. 28. ALL RESIDENTIAL DRIVEWAYS TO BE CONSTRUCTED IN ACCORDANCE WITH EDCM 501 TO 503. SINGLE DRIVEWAYS TO BE OFFSET 0.75m FROM SIDE BOUNDARY OR EASEMENT.

29. ALL ALLOTMENTS AND RESERVES SHALL BE SMOOTHED, GRADED AND SHAPED TO AN EVEN SURFACE.

30. APPROVAL FOR THE REMOVAL AND DISPOSAL OF ANY EXCAVATED MATERIAL OR TOPSOIL IS REQUIRED FROM COUNCIL.

31. THE CONTRACTOR TO ERECT STREET NAME SIGNS & POLE AS DIRECTED BY THE SUPERINTENDENT. 32. ALL LINEMARKING, SIGNING & TRAFFIC CONTROL DEVICES FOR THIS PROJECT TO BE IN ACCORDANCE WITH AUSTRALIAN STANDARD

AS1742. ALL LINEMARKING TO BE LONG LIFE THERMOPLASTIC PAINT. 33. CONFIRMATION OF THE ASPHALT WEARING COURSE IS TO BE DEFFERED UNTIL INSTRUCTED BY THE SUPERINTENDENT.

34. ALL EXOTIC (NON-NATIVE) TREES AND SHRUBS, INCLUDING DEAD TREES, NOT SHOWN ON THE DRAWINGS BUT LOCATED WITHIN THE WORKS AREA TO BE REMOVED AND DISPOSED OFFSITE.

35. ALL EXCAVATED OR FILLED AREAS OUTSIDE THE ROAD RESERVE SHALL BE SURFACED WITH A 100mm LAYER TOPSOIL AS SPECIFIED. ALL FILLING ON ALLOTMENTS TO BE COMPACTED TO 95% STANDARD COMPACTION IN 150mm LAYERS AND AS PER THE SPECIFICATION. WHERE THERE IS FILL IN EXCESS OF 300mm IN DEPTH, THE CONTRACTOR IS TO CARRY OUT SOIL TESTS TO THE REQUIREMENTS OF

SECTION 8 AS SPECIFIED IN AS3798-1996 TO SHOW THAT THE REQUIRED COMPACTION HAS BEEN ACHIEVED. 36. INSTALL BLUE RAISED REFLECTIVE PAVEMENT MARKER (BRRPM) ON ROAD CENTRELINE AND "GROUND BALL" MARKER POST TO INDICATE LOCATION OF FIRE PLUG.

37. UPON COMPLETION OF CONSTRUCTION, THE WHOLE SITE SHALL BE CLEANED UP AND GRADED OVER. ALL RUBBISH IS TO BE REMOVED AND THE SITE IS TO BE LEFT IN A CLEAN AND TIDY CONDITION TO THE SATISFACTION OF THE SUPERINTENDENT. 38. ALL DRAINAGE PIT COVERS AND GRATES IN ACCORDANCE WITH EDCM 601 TO 608

39. PIPE TRENCHES WITHIN THE ROAD RESERVE MUST BE BACKFILLED WITH 20mm CL3 CR TO BE COMPACTED TO A DRY DENSITY NOT LESS THAN 97% OF THE MAXIMUM FOUND IN THE STANDARD COMPACTION:

BENEATH THE ROAD PAVEMENT OR DRIVEWAY CROSSOVER TO THE UNDERSIDE OF THE PAVEMENT OR CROSSOVER. ADJACENT TO KERBING OR CONCRETE WORKS TO A LEVEL THAT IS NOT AFFECTED BY A 45° ANGLE OF REPOSE FROM THE NEAR

GAS - STANDARD NOTES

GAS MAINS, FITTINGS AND MARKER TAPE ARE TO BE SUPPLIED BY THE GAS AUTHORITY.

EXCAVATION, SUPPLY AND PLACEMENT OF REQUIRED BACKFILL TO BE BY OTHERS.

TWO WEEKS OF NOTIFICATION OF COMMENCEMENT OF EXCAVATION WORKS SHALL BE GIVEN TO THE GAS AUTHORITY.

WARNING SAFETY MEASURES REQUIRED

Please note there are risks attached to the construction of this project, and any ongoing maintenance of structures. Consider the safety of all. For potential risks, consequences and controls refer to Safety In Design Risk Register SID P4.E6. 3070E-007-500 SSESS THE RISK - STAY SAFE

WARNING BEWARE OF UNDERGROUND SERVICES

he locations of underground services are approximate only and

their exact position should be proven on site.

No guarantee is given that all existing services are shown.

ocate all underground services before commencement of works

DIAL 1100 BEFORE YOU DIG

www.1100.com.au

REVISION

355 G5 | 3070E-007-101

© SMEC 2021. Digital information supplied by this office is for information only, in the event of any discrepancies this should be discussed with the superintendent. Set out should be carried out in accordance with Relevant Authority standard drawings or as nominated by SMEC.

